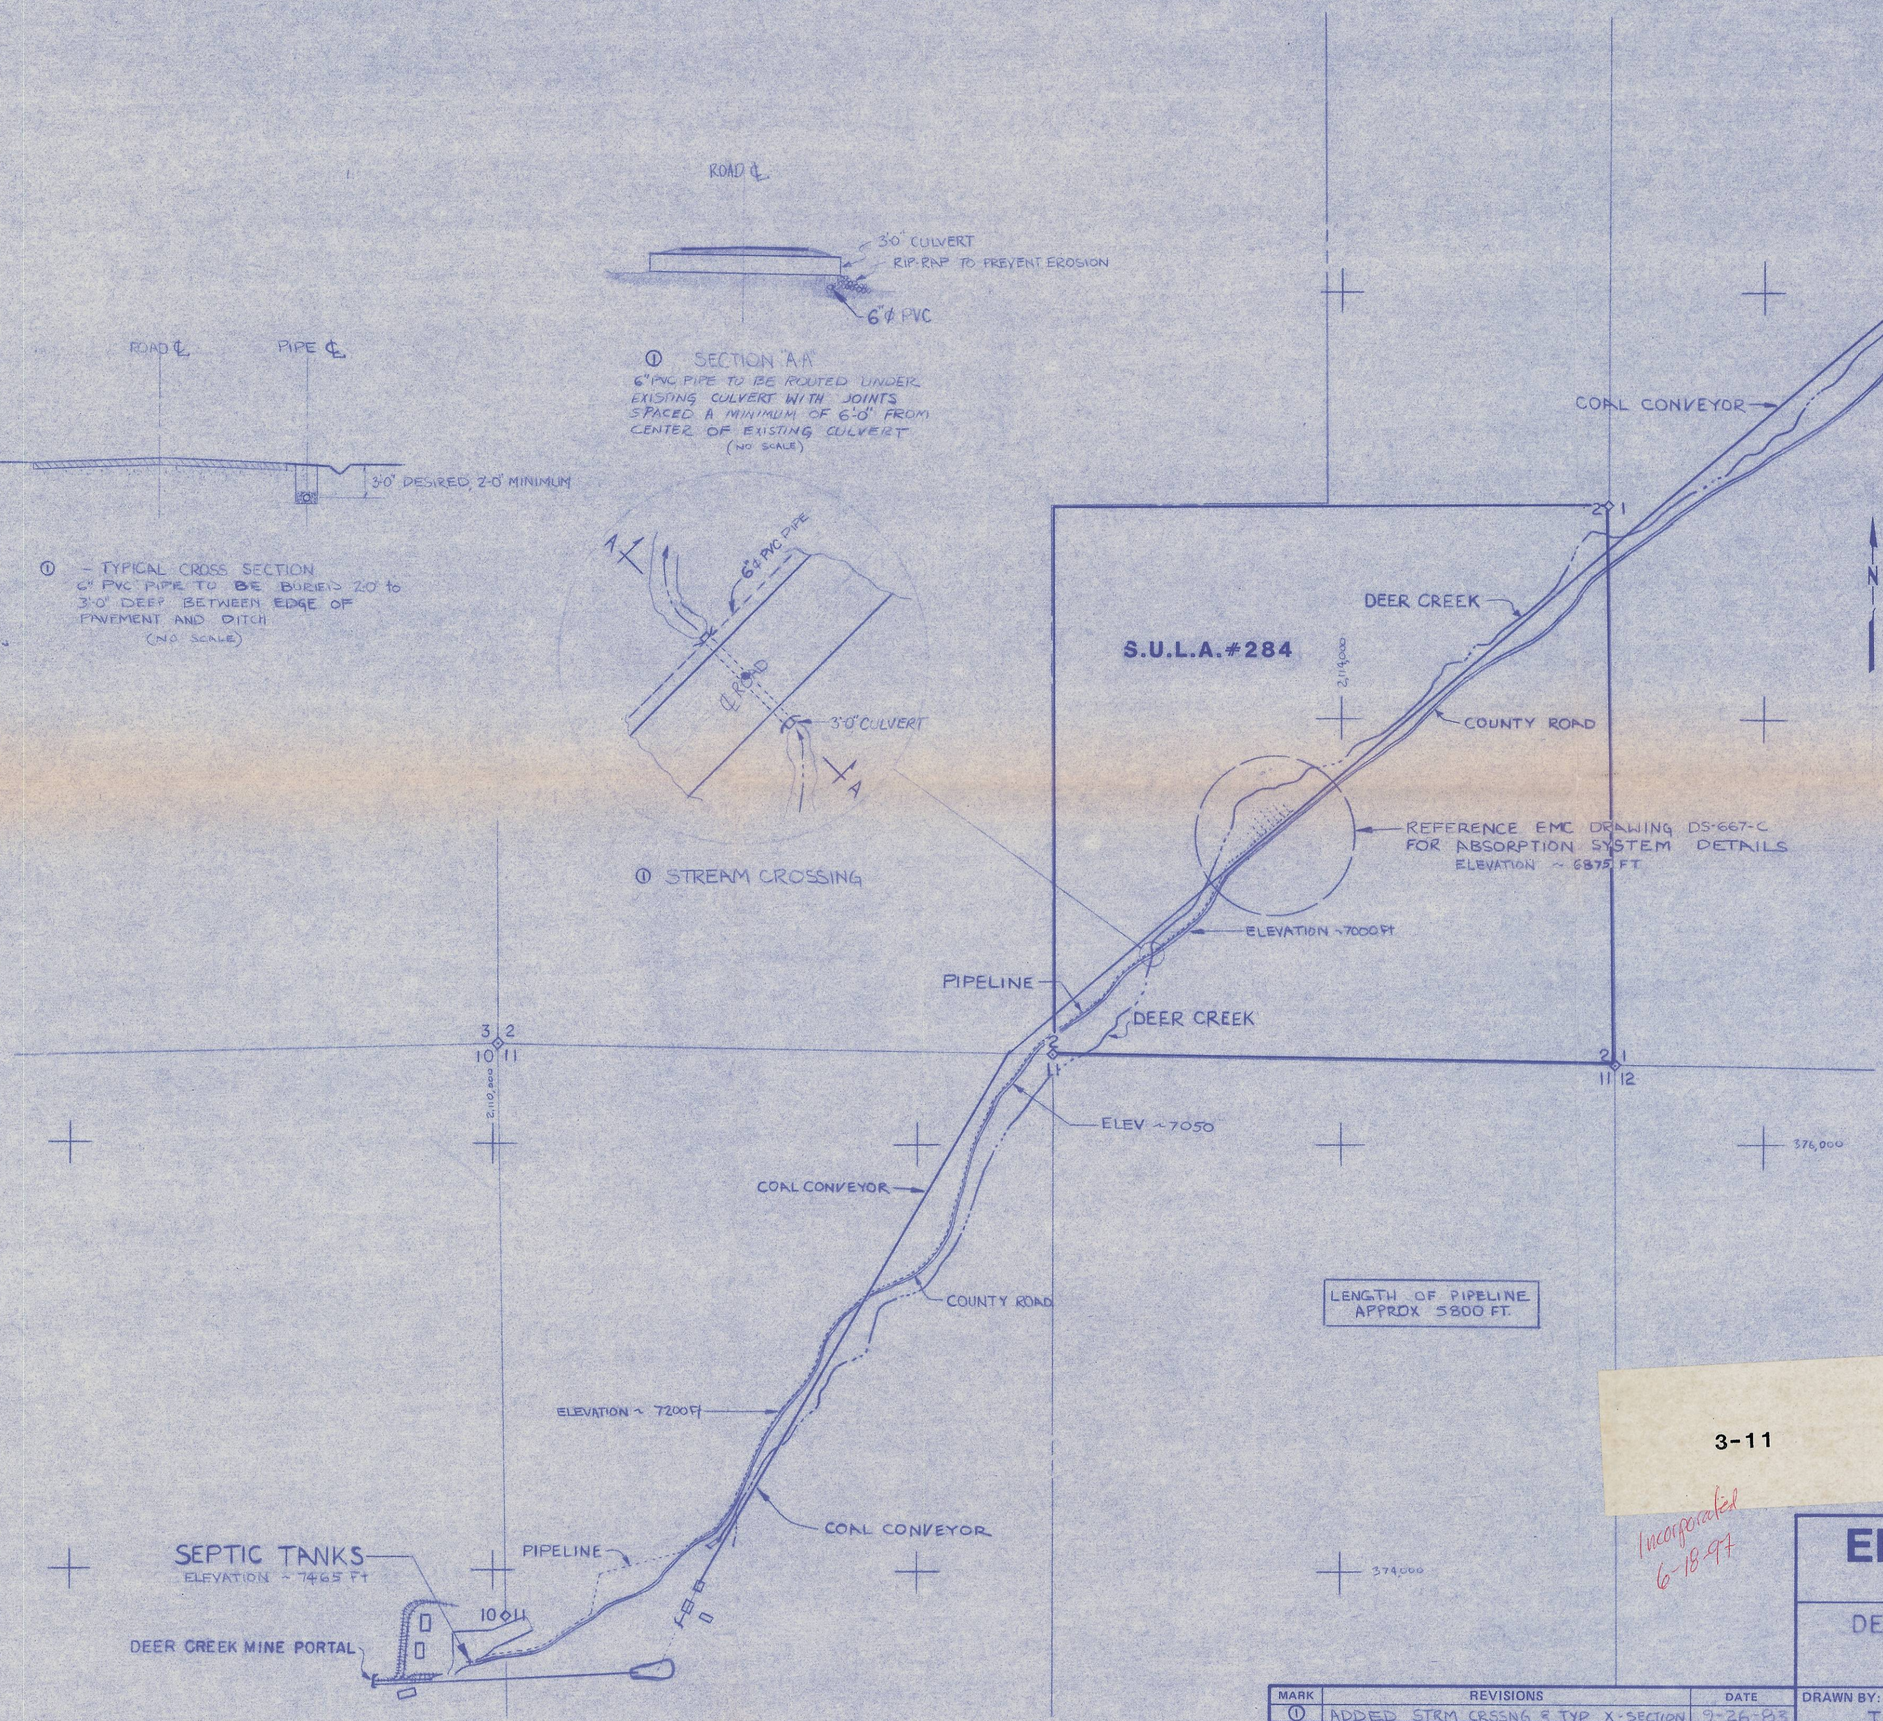

NOTES:

1. THE SEEPAGE AREA IS LOCATED IN THE SOUTHEAST QUARTER OF SEC 2, TOWNSHIP 17 SOUTH, RANGE 7 EAST
2. CLEAN OUTS LOCATED AT ALL HORIZ. BENDS AND 200 FT. MINIMUM SPACING (SEE DWG DS-667-C FOR TYPICAL CLEANOUT DETAILS)
3. PIPE SHALL BE 6"ø PVC PRESSURE RATED PIPE WITH O-RING GASKET CONNECTIONS - 150 PSI ABOVE 7200 Ft; 250 PSI 7200 to 7000 Ft; 300 PSI BELOW 7000 Ft.

3-11

Incorporated 6-18-97

REGISTERED PROFESSIONAL ENGINEER No. 5211 LARRY GUYMON State of Utah

EMERY MINING CORP.

HUNTINGTON, UTAH 84528

DEER CREEK SEWER PIPELINE
PLAN VIEW

MARK	REVISIONS	DATE
①	ADDED STRM CRSSNG & TYP X-SECTION	9-26-83

DRAWN BY:	APPROVED BY:	DRAWING NO.
TJF		DS-668-C
SCALE: 1" = 500'	DATE: 8-24-83	