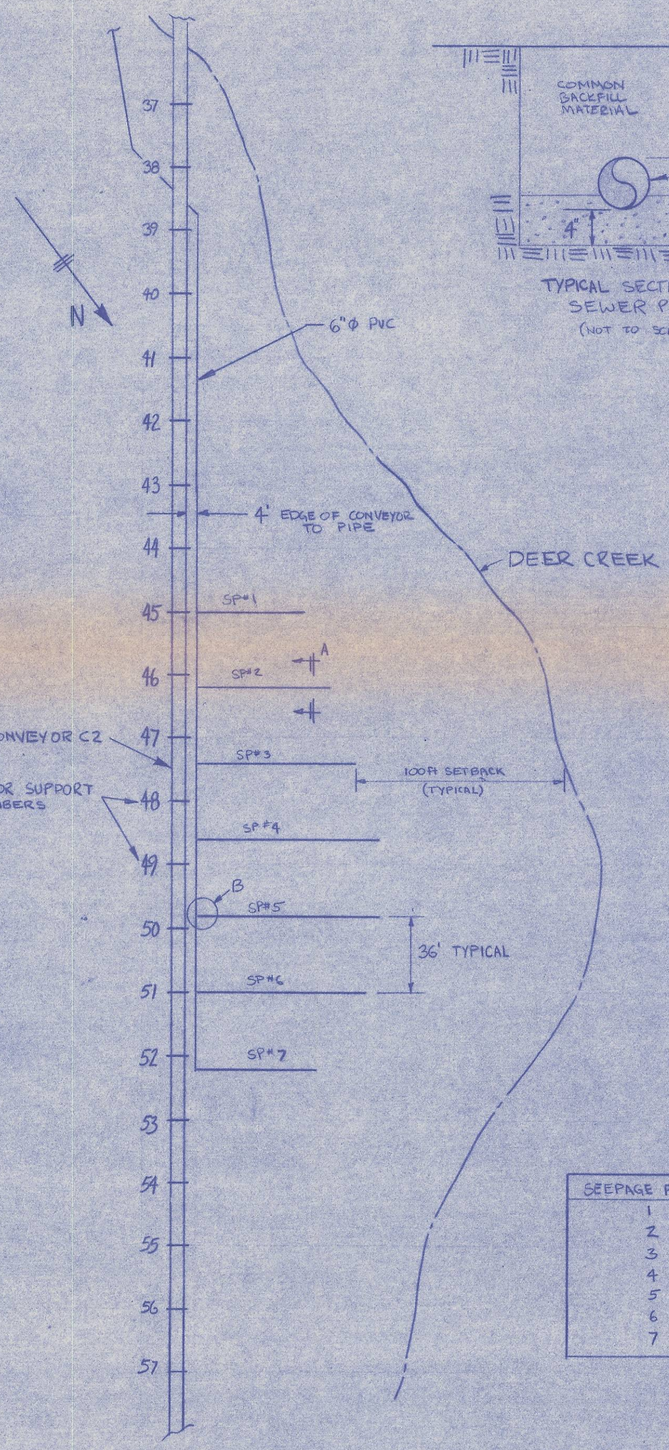

SEEPAGE PIT LAYOUT

SCALE 1" = 50'-0"

SEEPAGE PIT #	LENGTH
1	51 Ft
2	63
3	75
4	87
5	87
6	81
7	57

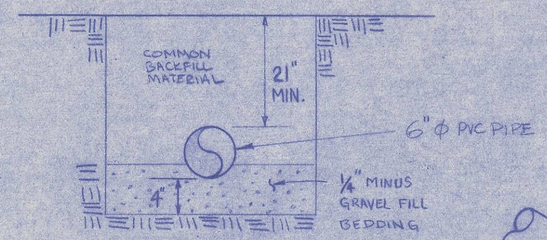

TYPICAL SECTION SEWER PIPE

(NOT TO SCALE)

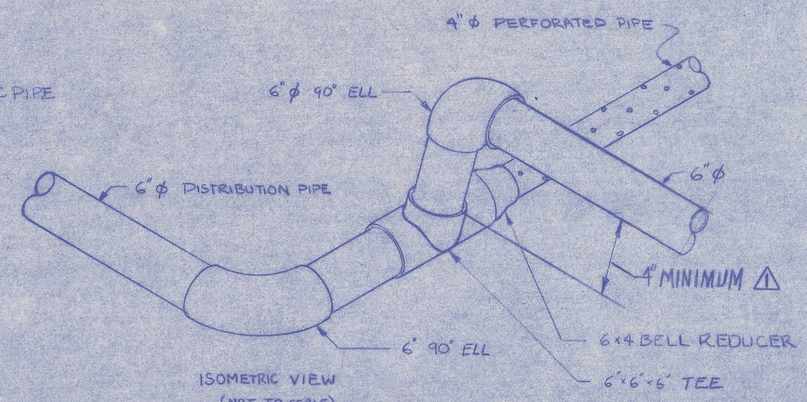

ISOMETRIC VIEW

(NOT TO SCALE)

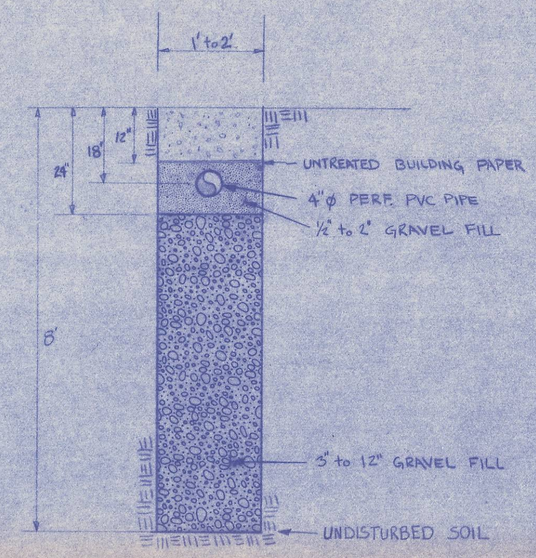

SECTION A

SCALE 1" = 2'-0"

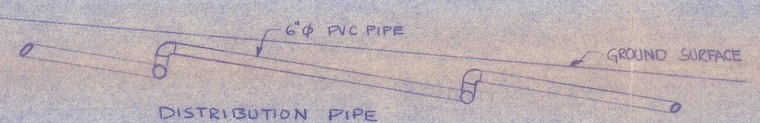

DISTRIBUTION PIPE ELEVATION VIEW

(NOT TO SCALE)

SECTION B

3-11a

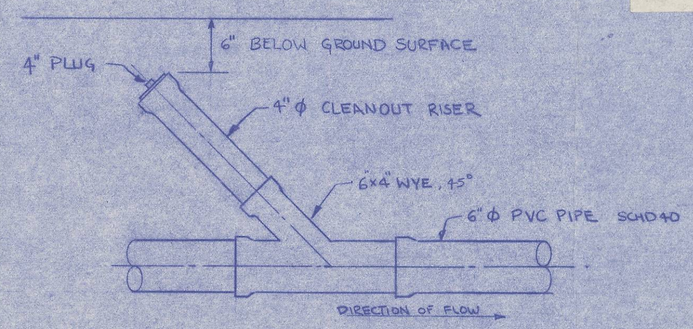

TYPICAL CLEAN OUT

SCALE 1" = 1'-0"

REGISTERED PROFESSIONAL ENGINEER No. 5214 LARRY GUYMON State of Utah

NOTES

1. CLEAN OUTS SPACED EVERY 200 FEET ALONG PIPE BETWEEN SEPTIC TANKS AND SEEPAGE PITS AND AT ALL HORIZONTAL BENDS
2. ALL PIPE SHALL BE PRESSURE RATED PVC PIPE WITH O-RING GASKET CONNECTIONS

RATING SCHEDULE - MINIMUM RATING
ABOVE 7200 ft ELEV - 150 PSI
7200 to 7000 ft ELEV - 250 PSI
BELOW 7000 ft ELEV - 300 PSI

Incorporated 6-18-97

EMERY MINING CORP.

HUNTINGTON, UTAH 84528

DEER CREEK SANITATION SYSTEM
SEEPAGE PIT DESIGN

MARK	REVISIONS	DATE
⚠	ADDED MIN. RISER LENGTH	9-30-83

DRAWN BY:	APPROVED BY:	DRAWING NO.
TJF		DS-667-C
SCALE: As Noted	DATE: 8-24-83	