FOR CONSTRUCTION

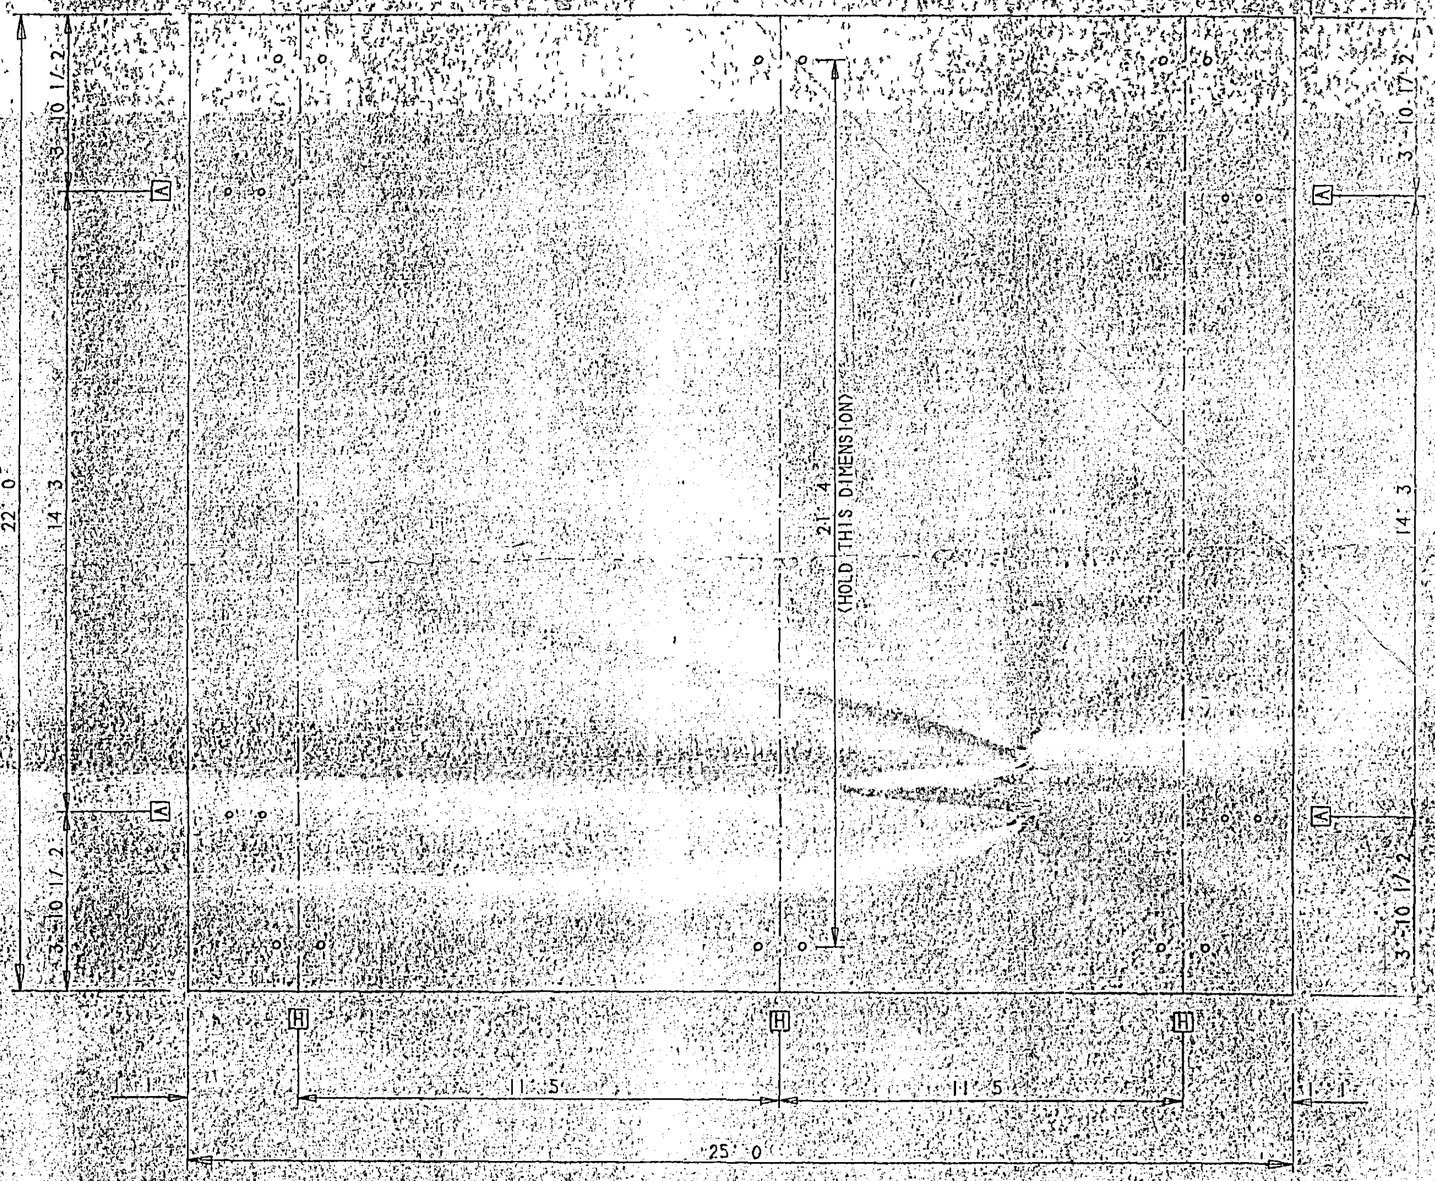

	DESCRIPTION	SUPPORT	REACTION (KIPS) HORIZ	VERT
1	1.0D+1.0L	1	-1.35	12.94
1	1.0D+1.0L	2	1.35	12.94
2	1.0D+1.0S	1	-1.35	12.94
2	1.0D+1.0S	2	1.35	12.94
3	1.0D+1.0Z	1	.05	.28
3	1.0D+1.0Z	2	.12	.48
4	1.0D+1.0W C1	1	1.26	-2.33
4	1.0D+1.0W C1	2	1.29	-.61
5	1.0D+1.0W C2	1	1.62	-1.53
5	1.0D+1.0W C2	2	.94	.19
6	1.0D+.5S+1.0W C1	1	.77	2.38
6	1.0D+.5S+1.0W C1	2	1.78	4.10
7	1.0D+.5S+1.0W C2	1	1.13	3.16
7	1.0D+.5S+1.0W C2	2	1.43	4.90
8	1.0D+1.0S+.5W C1	1	.37	8.40
8	1.0D+1.0S+.5W C1	2	1.64	9.26
9	1.0D+1.0S+.5W C2	1	[illegible]	8.80
9	1.0D+1.0S+.5W C2	2	1.47	9.66
10	1.0D+1.0S+1.0Z	1	.95	9.63
10	1.0D+1.0S+1.0Z	2	1.07	9.74

QTY	DESCRIPTION	PROJECTION (IN)
8	AB 5/8	1.50
12	AB 3/4	2.00









NOTE: ALL TAIL DIMENSIONS FOR OPENINGS ARE FROM STEEL LINE
ALL WALKDOORS AND WINDOWS ARE TO BE FIELD LOCATED

WASH BLDG

DATE 11/ 9/1994 TIME 14:07:18

BUILDING CRITERIA/CODE	UBC91
LIVE LOAD	94PSF
SNOW LOAD	94PSF
WIND LOAD	20PSF
SEIZ ZONE	3
OTHER	N/A

SCALE NTS

#	REVISIONS DESCRIPTION	DATE	BY

BUILDING SYSTEMS

CUSTOMER Cypress Christian Center
LOCATION Corona
BUILDER N/A
JOB NO. 94104 SHEET NO.

Licensed Structural Engineer No. S-2071 State of U.S.A.

NOV 28 1994