

ACT/007/018
PDR #2

0001

FACSIMILE COVER PAGE



Mine Office (801) 637-6360
Fax No. (801) 637-0108

SOLDIER CREEK COAL COMPANY

A SUBSIDIARY OF THE COASTAL CORPORATION
P. O. BOX 7001 • PRICE UT 84501 • 801/637-6360

TO: WAYNE WESTERN LOCATION: DOGM 359-3940

FROM: TOM PALUSO LOCATION: SC³

THIS TRANSMISSION CONSISTS OF 6 PAGES INCLUDING COVER PAGE

MESSAGE:

ATTACHED IS THE INFORMATION THAT YOU WANTED
CONCERNING THE REMOVAL OF THE DIESEL TANK AT
THE NO. 2 FAN.

MARK CRIM - DEPT. OF ENVIRONMENTAL QUALITY SAID TODAY
THAT HE IS APPROVING OUR REMOVAL PLAN AS OF TODAY.

TOM

WE NEED APPROVAL FROM THE DIVISION ASAP.
IF YOU HAVE ANY QUESTIONS, PLEASE CALL.

CONFIDENTIALITY NOTICE: This message is intended only for the use of the individual or entity designated above. It is confidential and may contain information that is legally privileged or exempt from disclosure under applicable law. You are hereby notified that any dissemination, distribution, copying or use of or reliance upon the information contained in and transmitted with this facsimile transmission by or to anyone other than the recipient designated above by the sender is not authorized and strictly prohibited. If you have received this communication in error, please immediately notify the sender by telephone and return it to the sender by U. S. Mail, or destroy it if authorization is granted by the sender. Thank You.

If you have any trouble with this transmission, please call Soldier Creek Coal Company at (801) 637-6360.



Coastal
The Energy People

December 16, 1993

State of Utah Department of Environmental Quality
Division of Environmental Response and Remediation UST Section
150 North 1950 West 2nd Floor
Salt Lake City, UT 84116

RE: Soldier Creek Coal Company
Closure Plan - Underground Storage Tank

Gentlemen:

Enclosed you will find a Underground Storage Tank Closure Plan for a 1000 gallon diesel storage tank, which is located at the Soldier Canyon Mine. We would like to start removal of this tank as soon as possible.

Your timely response to our application would be greatly appreciated. If you have any questions, please contact me.

Sincerely,

SOLDIER CREEK COAL COMPANY

J. T. Paluso
Chief Engineer

cc: Mr. Mark Grim
Environmental Health District
28 South 100 East
Price, UT 84501

Soldier Creek Coal Company


A SUBSIDIARY OF THE COASTAL CORPORATION


BMT
 BROWN-MINNEAPOLIS TANK


SURE -  ®

DOUBLE WALL ABOVEGROUND STORAGE TANKS

The SURE- ® by Brown - Minneapolis Tank is a UL-142 listed and approved double wall aboveground storage tank. The SURE- ® ranges in size from 265 to 30,000 gallon capacities and is available in horizontal or vertical configurations. The vertical tank design comes standard with the exclusive BMT free-flow bottom.

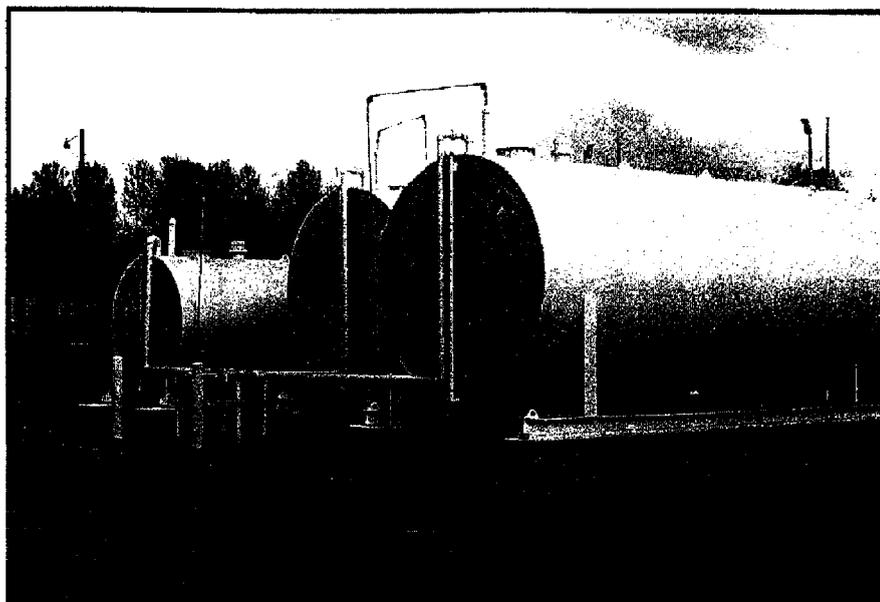


**Underwriters
Laboratories Inc.®**

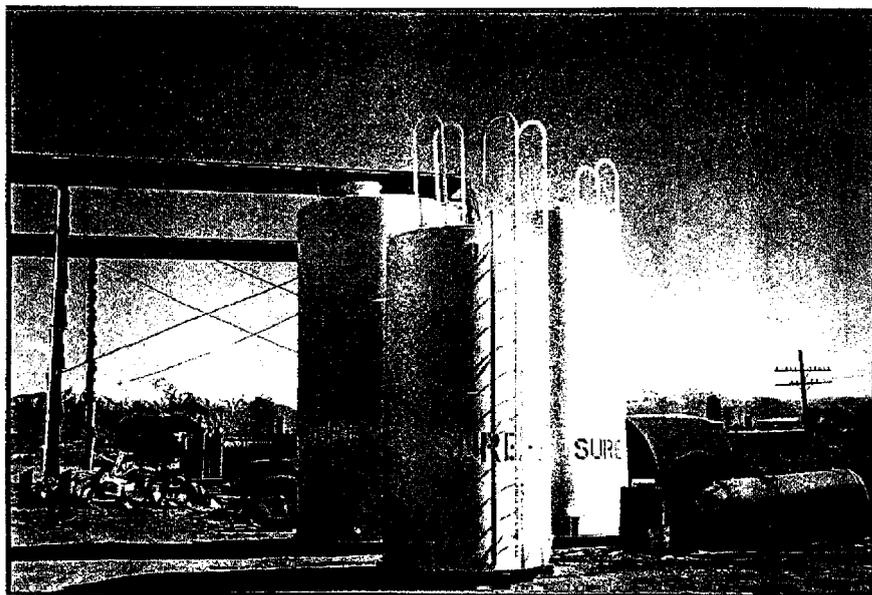

The SURE- ® complies with all requirements of NFPA 30 for steel aboveground tanks for flammable and combustible liquids. Due to the unique UL design, the SURE- ® is installed without a dike. The interstitial space of this tank can be continuously monitored making this tank the safest and most reliable secondary containment system for aboveground storage.

BROWN-MINNEAPOLIS TANK

a national leader in steel storage tank technology

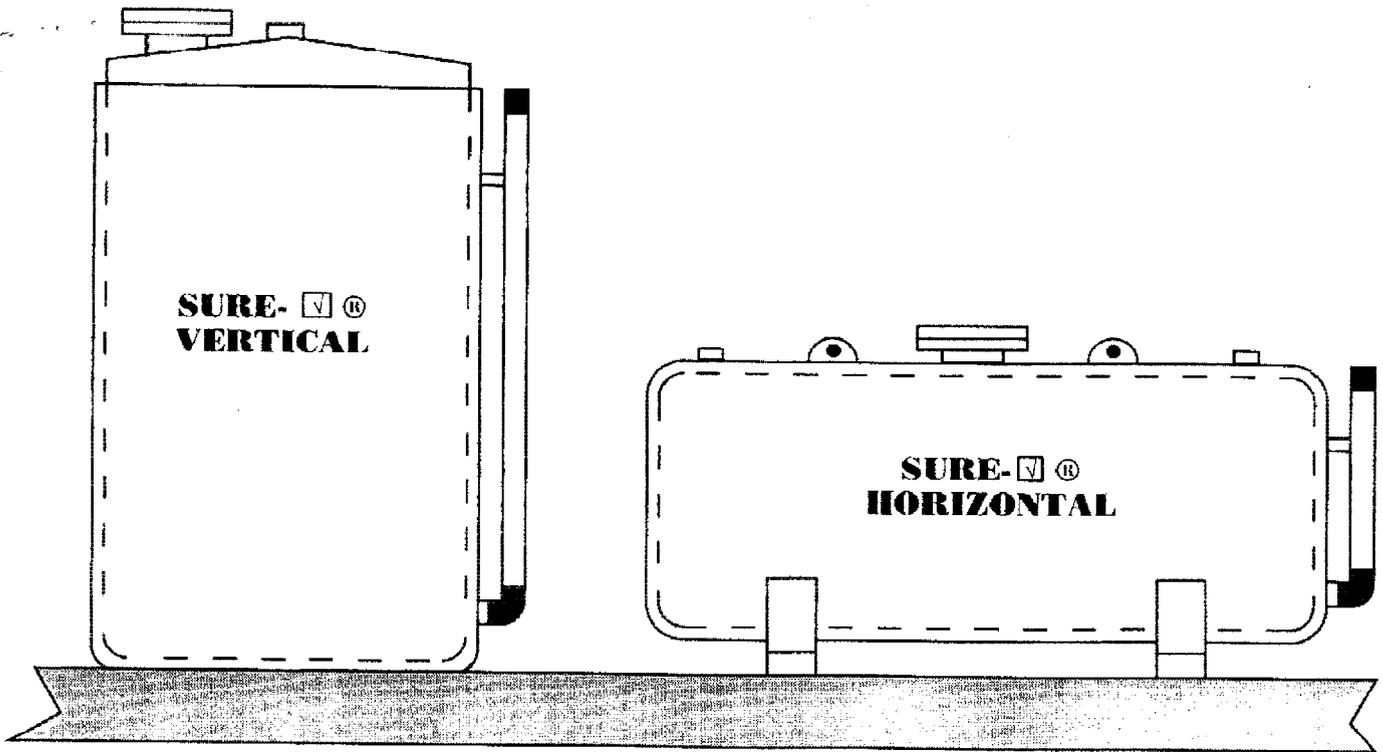

DOUBLE WALL ABOVEGROUND STORAGE TANKS

Standard Openings Included Per UL Requirements:

- Emergency Vents (long bolt manway may be used)
 - Monitoring Well
 - Normal Vents
 - Manways
 - Outlet
 - Drain
 - Inlet

Available Options:

- Special Coatings (Interior and Exterior)
- Saddles for Horizontal Tanks
- Skids for Horizontal Tanks
- Additional Openings
 - Platforms
 - Ladders
 - Heaters



BMT
BROWN-MINNEAPOLIS TANK



SALES/MANUFACTURING LOCATIONS:


ST. PAUL
P.O. BOX 64670
ST. PAUL, MINNESOTA 55164
612/454-6750

PROVO
P.O. BOX 697
PROVO, UTAH 84603
801/373-8520


BIRMINGHAM
P.O. BOX 10785
BIRMINGHAM, ALABAMA 35202
205/841-0402

SURE-[®] DOUBLE WALL ABOVEGROUND TANKS

Horizontal • 360° Wrapped • Secondary Containment • '42

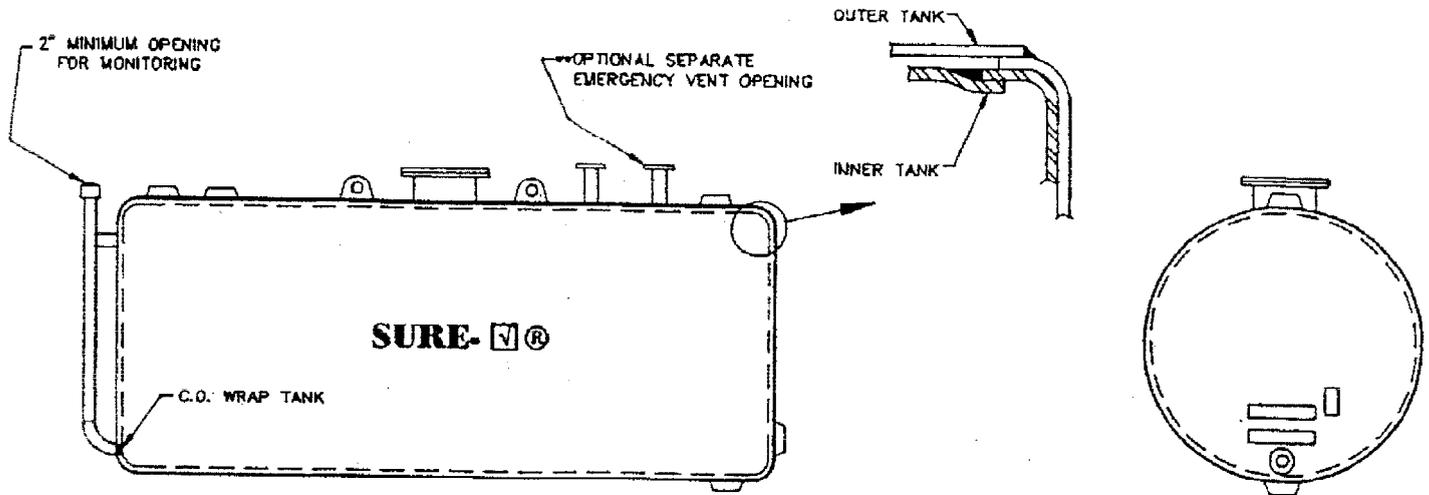

BMT STANDARD DIMENSIONS



CAPACITY (Gallons)	DIAMETER	LENGTH	INSIDE TANK		OUTSIDE TANK		Sq. Ft. (Approx.)	Wt. Lbs. (Approx.)
			HEAD THK.	SHELL THK.	HEAD THK.	SHELL THK.		
560	4'	6'	10 ga.	10 ga.	10 ga.	10 ga.	100	1200
1000	64"	6'	10 ga.	10 ga.	10 ga.	10 ga.	150	1800
2000	64"	12'	7 ga.	7 ga.	7 ga.	10 ga.	250	3600
3000	64"	18'	7 ga.	7 ga.	7 ga.	10 ga.	350	5300
4000	64"	24'	7 ga.	7 ga.	7 ga.	10 ga.	450	6200
4000	7'	14'	1/4"	1/4"	5/16"	10 ga.	385	7300
6000	8'	16'	1/4"	1/4"	5/16"	10 ga.	503	9500
8000	8'	21'	1/4"	1/4"	5/16"	10 ga.	630	11500
10000	8'	27'	1/4"	1/4"	5/16"	10 ga.	780	13900
12000	8'	32'	1/4"	1/4"	5/16"	10 ga.	905	15900
15000	11'	21'	5/16" *	1/4"	5/16"	10 ga.	916	19400
15000	10'	25'-6"	5/16" *	1/4"	5/16"	7 ga.	960	24400
20000	11'	28'	5/16" *	1/4"	5/16"	7 ga.	1158	23700
20000	10'	34'	5/16" *	1/4"	5/16"	7 ga.	1225	31200
25000	11'	36'	5/16" *	1/4"	5/16"	7 ga.	1435	28600
30000	11'	42'	5/16" *	1/4"	5/16"	7 ga.	1642	32400

*1/4" heads may be used with head braces per UL 142 / **If long bolt manway is used, this E.V.O. may be deleted.



STANDARD SPECIFICATIONS

- Tank meets F921-92 standard.
- Double wall design approved by Underwriters Laboratories.
- Tanks bear the UL label for secondary containment.
- Other tank sizes available upon request.
- BMT standard opening locations and two (2) lifting lugs.
- Exterior is blasted and painted with one (1) coat of shop primer.
- BMT's exclusive free flow design.
- Check with Mfg. plant for type of Emergency Vent Opening supplied.




PROVO

520 West 2000 South
Provo, UT 84058
(801) 373-8520

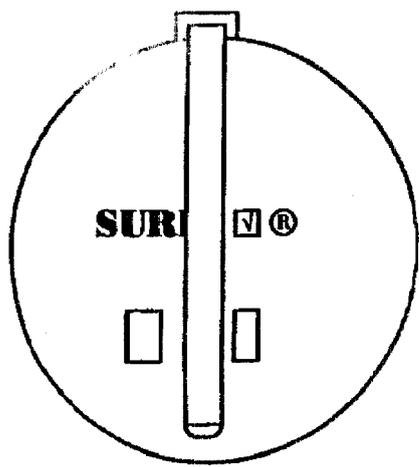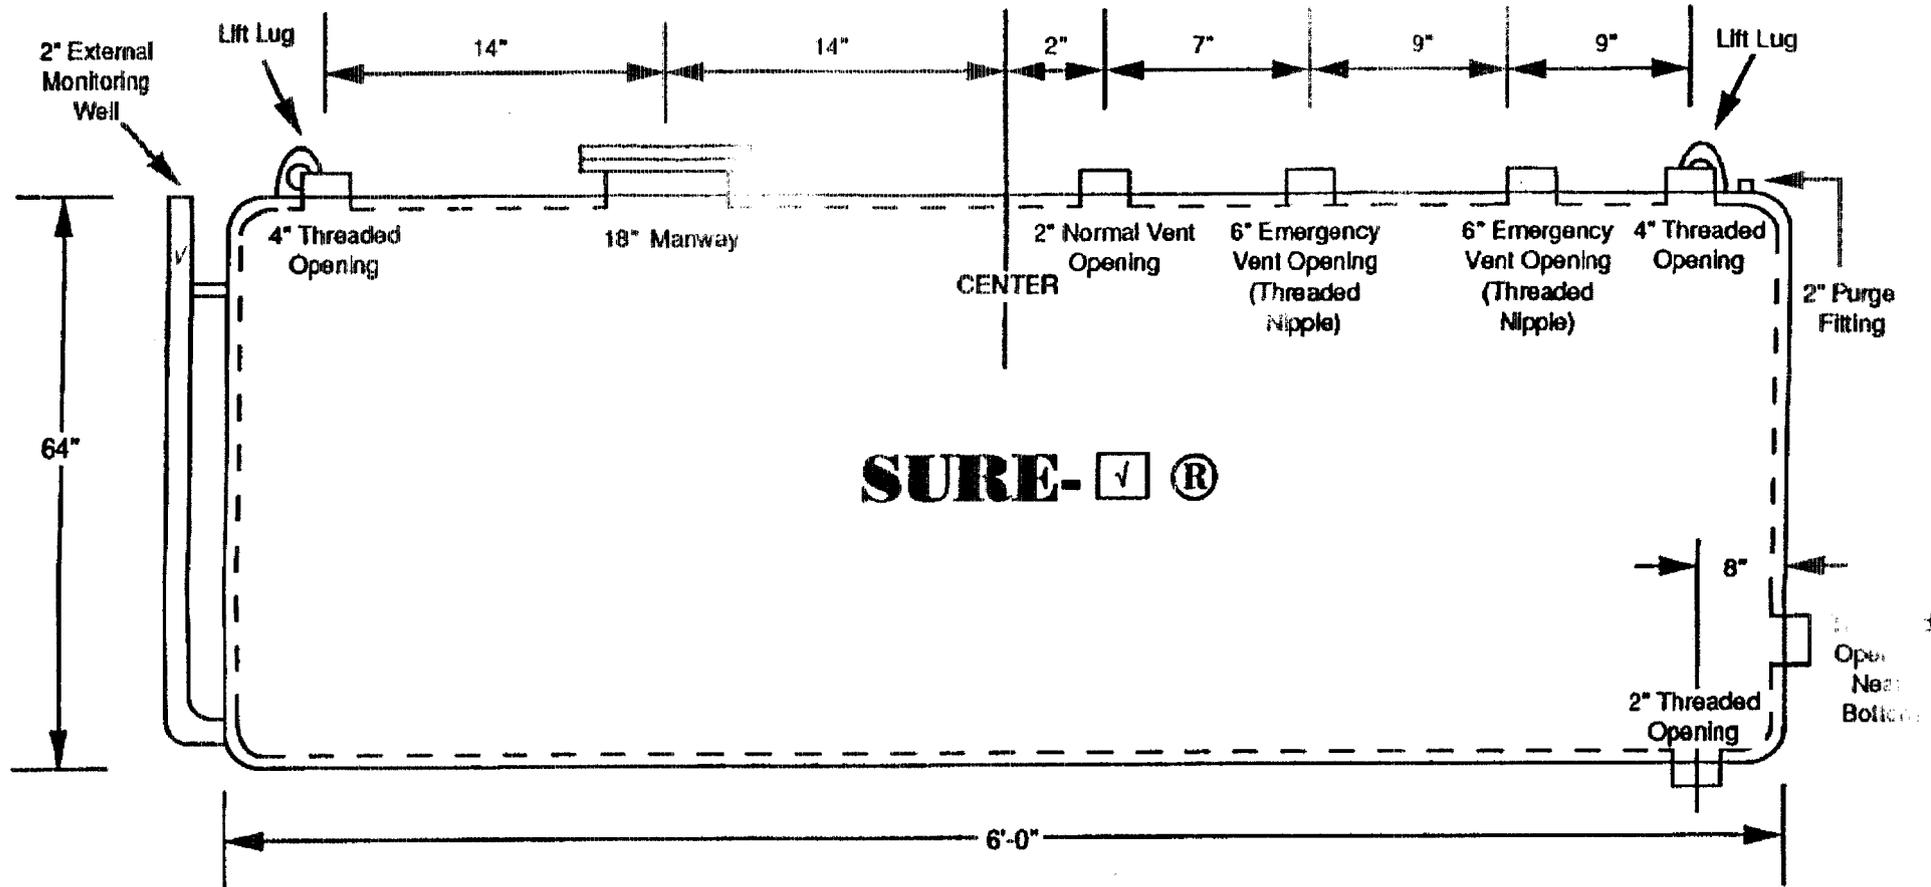

TYPICAL END VIEW

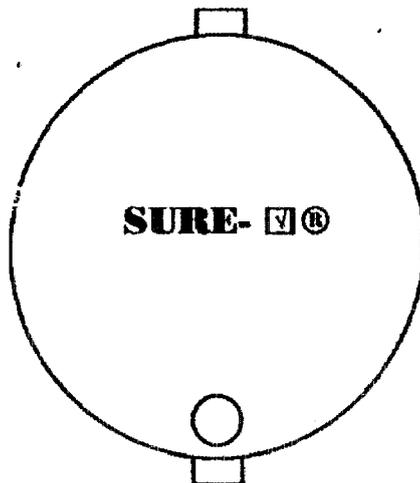

TYPICAL END VIEW



SURE-√®
DOUBLE WALL
ABOVEGROUND TANK
HORIZONTAL

CAPACITY (Gal.)	WEIGHT (lbs.)	MINIMUM THICKNESS		
		INNER TANK	OUTER TANK SHELL	HEADS
1000	1800	10 GA.	10 GA.	10 GA.

- * Tank openings shown are all BMT standards.
- * Tank system meets UL 142 requirements.
- * Outside of tank is sandblasted.
- * Outside of tank to receive one coat of standard shop primer.
- * No normal vent fittings are supplied with tank.