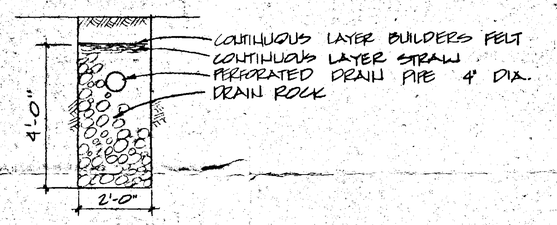

1 SECTION THRU SEEPAGE TRENCH
SCALE 1/2" = 1'-0"

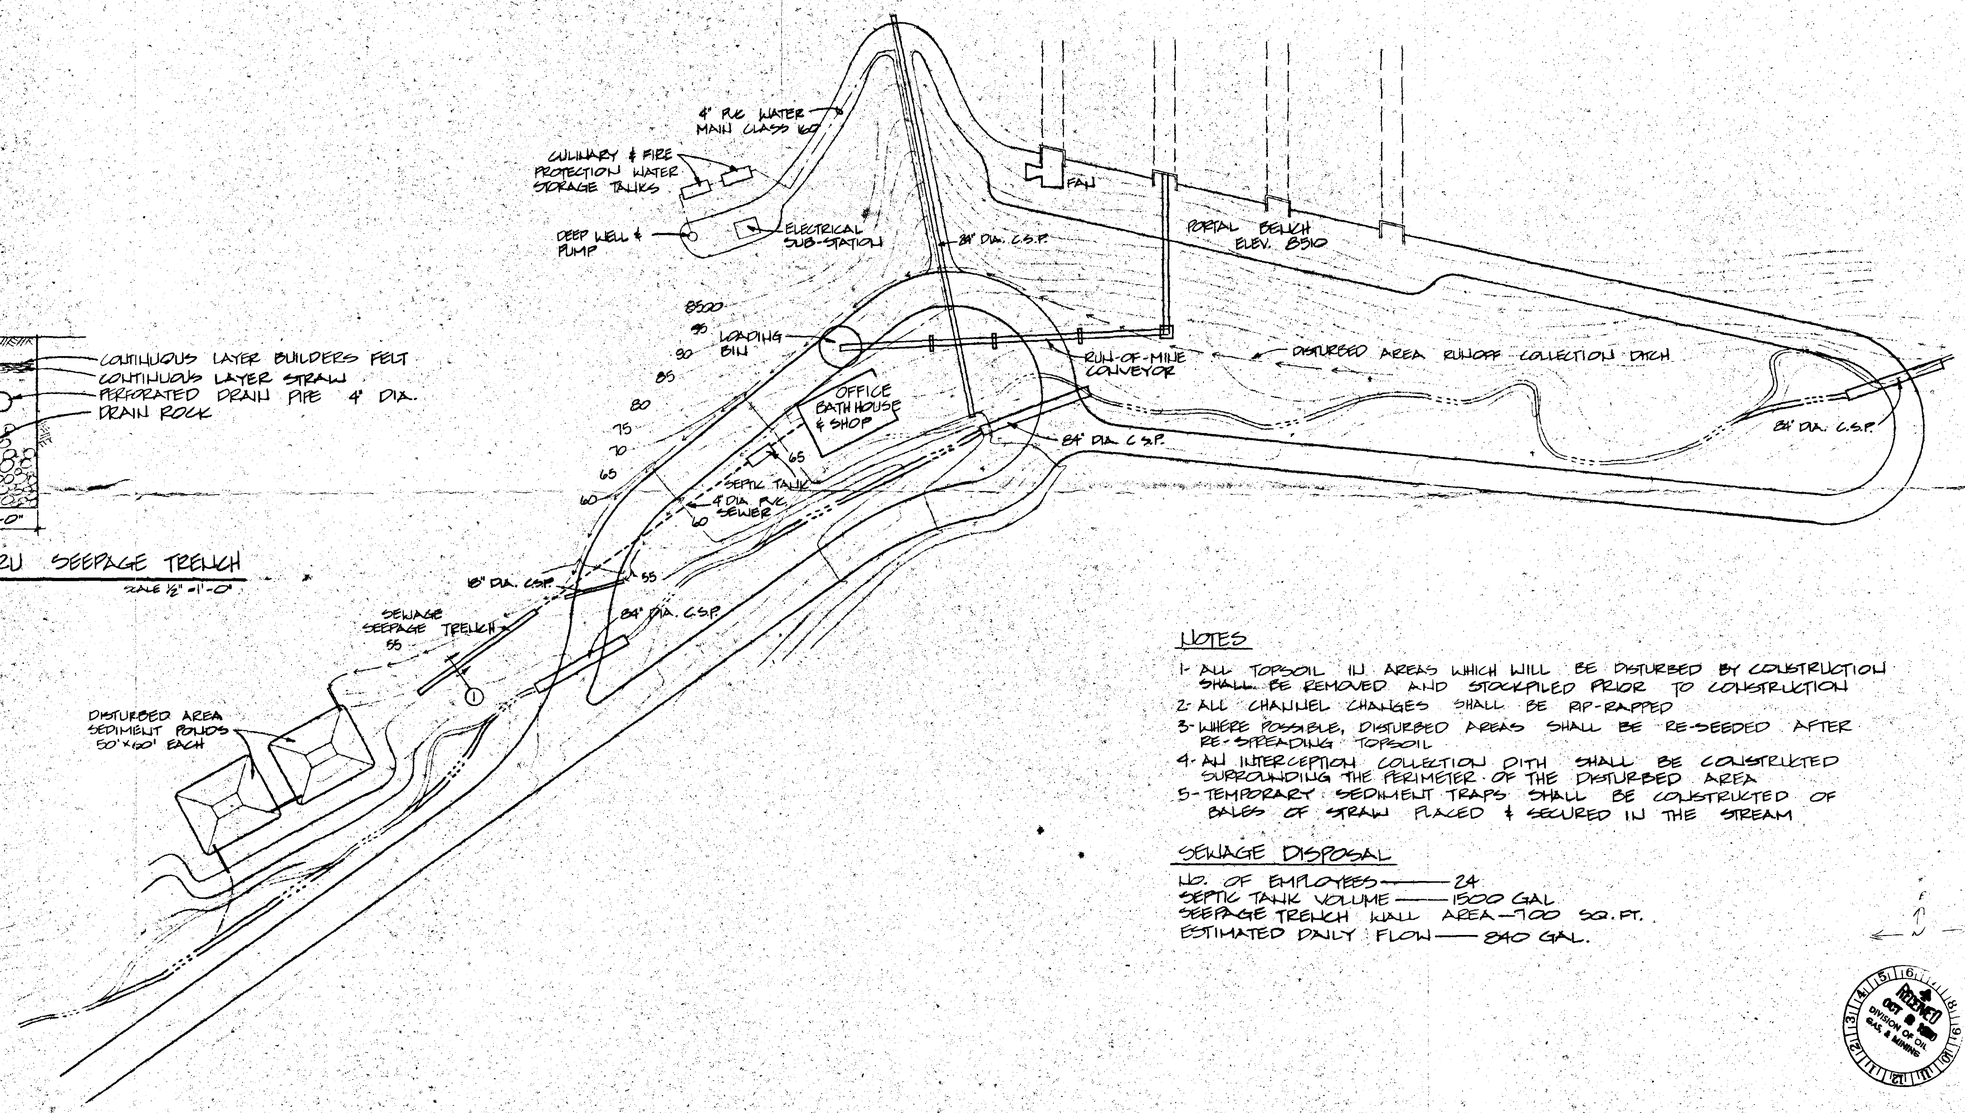

NOTES

1. ALL TOPSOIL IN AREAS WHICH WILL BE DISTURBED BY CONSTRUCTION SHALL BE REMOVED AND STOCKPILED PRIOR TO CONSTRUCTION
2. ALL CHANNEL CHANGES SHALL BE RIP-RAPPED
3. WHERE POSSIBLE, DISTURBED AREAS SHALL BE RE-SEEDED AFTER RE-SPREADING TOPSOIL
4. AN INTERCEPTION COLLECTION DITH SHALL BE CONSTRUCTED SURROUNDING THE PERIMETER OF THE DISTURBED AREA
5. TEMPORARY SEDIMENT TRAPS SHALL BE CONSTRUCTED OF BALES OF STRAW PLACED & SECURED IN THE STREAM

SEWAGE DISPOSAL

NO. OF EMPLOYEES —— 24
SEPTIC TANK VOLUME —— 1500 GAL
SEEPAGE TRENCH WALL AREA — 700 SQ. FT.
ESTIMATED DAILY FLOW —— 840 GAL.

RECEIVED OCT 8 1980 DIVISION OF OIL, GAS & MINING

APPROVED:	THIS DRAWING IS PART OF:
DATE	PURCHASE ORDER(S)
CLIENT DATE	(SUB)CONTRACT(S)

REV.	DATE

NO.	BY/MN	CH'KD.	SUPRV.	APPROVED	DATE	REVISION	REFERENCE DRAWINGS

DESIGNED BY ORA
DRAWN BY ORA
CHECKED BY
APP'D.

OFFICE SALT PRICE
DATE 9/23/80
SCALE 1" = 50'

Boyle Engineering Corporation
consulting engineers/architects
268 West 400 South, Suite 301
Salt Lake City, Utah 84101
Energy is our Business

CLIENT T.O.E. INVESTMENT

TITLE BLAZON MINE NO. 1.
SITE LAYOUT

DRAWING NO.

PROJECT NO.

REVISION NO.