



- NOTE:
1. TERRACES ARE TO BE CONSTRUCTED APPROXIMATELY FOR EVERY 25' TO 35' RISE IN ELEVATION, TO CONTROL DRAINAGE AND ALLOW FOR MAINTENANCE TO THE EXCESS SPOIL DISPOSAL AREA.
 2. THE SLOPE OF THE DRAINAGE DIVERSIONS SHALL BE 0.5% MIN. TO 4% MAX.

TYPICAL TERRACE DETAIL
NTS

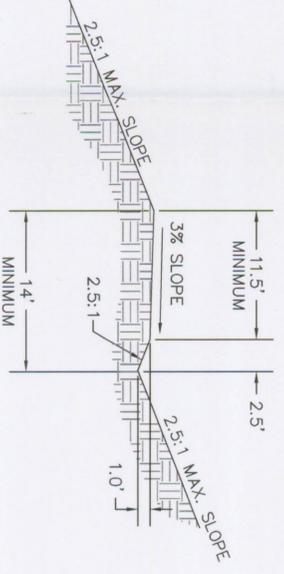

LEGEND

- PERMIT BOUNDARY
- EXCESS SPOILS BOUNDARY

REV	DATE	DESCRIPTION	BY	APP'D
△				
△	11/10	BOUNDARY AND TOPO UPDATES	AH	
△	9/02	2002 PERMIT RENEWAL	AH	
△				

DESIGNED	AH
DRAWN	AH
CHECKED	SSC

TWIN PEAKS
Engineering & Land Surveying
2264 NORTH 1450 EAST LEHI, UTAH 84043
(801) 450-3511, (801) 439-0700 FAX

Sunnyside Cogeneration Associates
EXCESS SPOIL DISPOSAL AREA #1 DESIGN
FINAL SURFACE CONFIGURATION

9-11-94
SCALE 1" = 100'
PROJECT NO. -



9-1B
RECEIVED
JUL 27 2011
DIV. OF OIL, GAS & MINING

File in: Confidential
 Shelf
 Expandable
Date Folder: 7/27/0070035
S. Comings