


Appendix 3-14

Sewage Plans

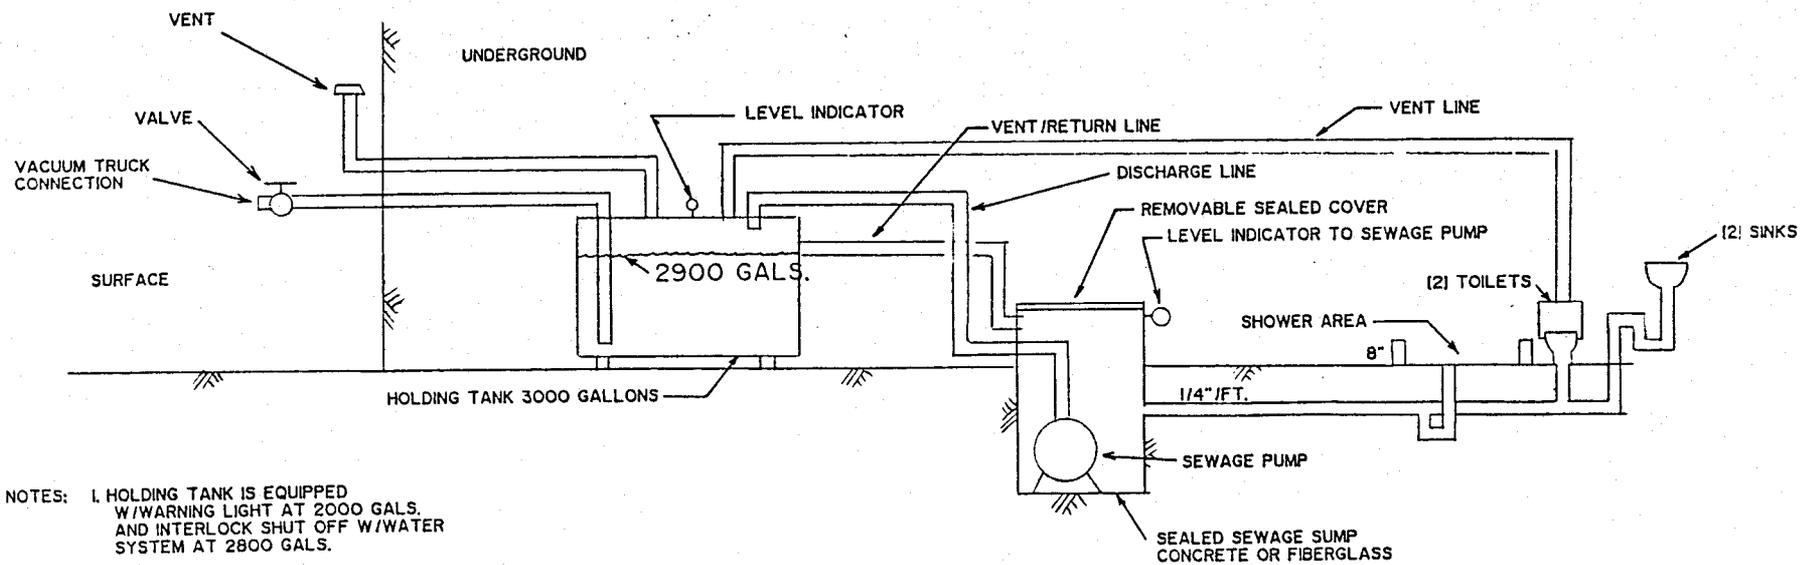

- NOTES:
1. HOLDING TANK IS EQUIPPED W/WARNING LIGHT AT 2000 GALS. AND INTERLOCK SHUT OFF W/WATER SYSTEM AT 2800 GALS.
 2. ALL EQUIPMENT WILL MEET OR EXCEED UTAH HEALTH DEPT. REGULATIONS

GENWAL COAL COMPANY
 CRANDALL CANYON MINE
 SEWAGE SYSTEM
 3-14 FEB. 10, 1988