Appendix 5-12

Sewage Plans

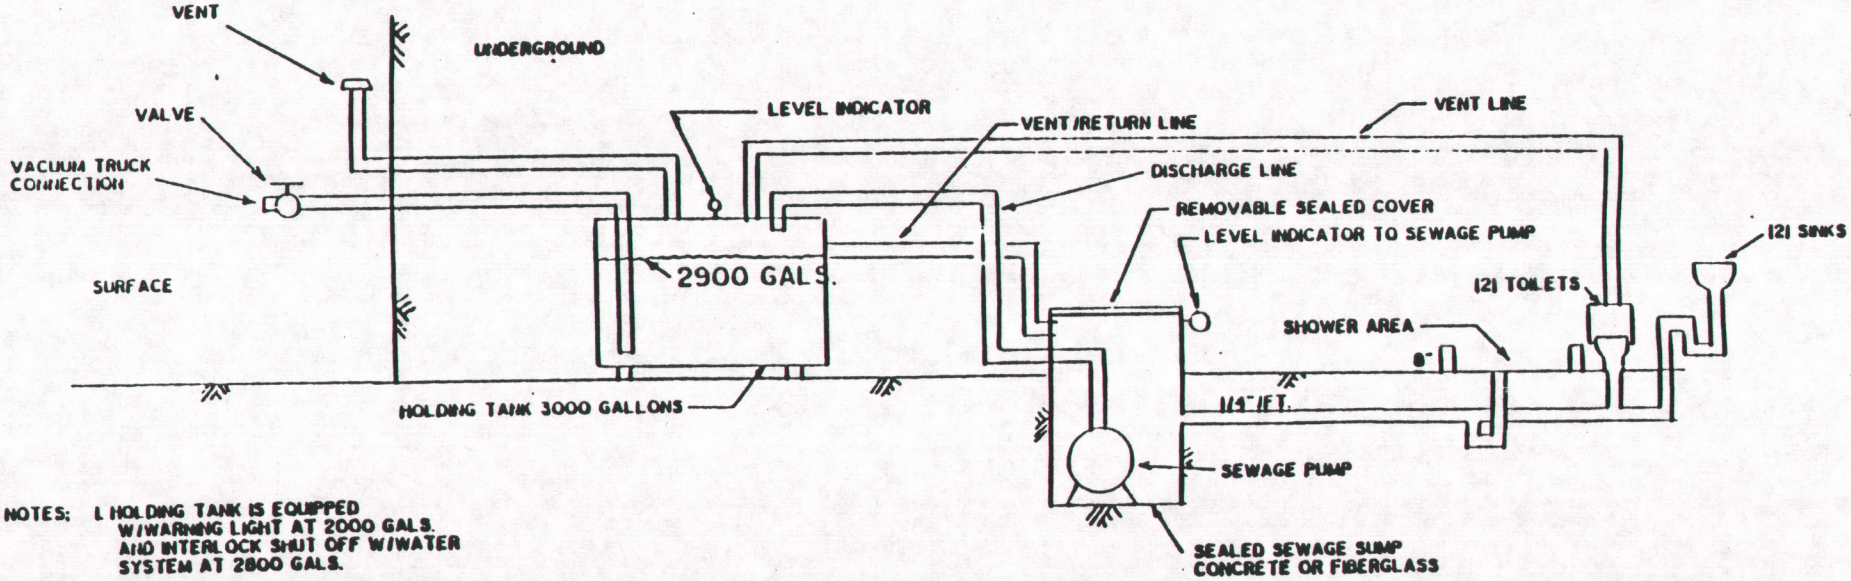

NOTES:
1. HOLDING TANK IS EQUIPPED W/WARNING LIGHT AT 2000 GALS. AND INTERLOCK SHUT OFF W/WATER SYSTEM AT 2800 GALS.
2. ALL EQUIPMENT WILL MEET OR EXCEED UTAH HEALTH DEPT. REGULATIONS

GENWAL COAL COMPANY
CRANDALL CANYON MINE

SEWAGE SYSTEM
3-14 FEB. 10, 1988